


BILL OF MATERIALS

ITEM	QTY.	DESCRIPTION	MGF - PART NUMBER
1	1	BUILDING 6' x 10' x 7'	BEVCO ECS-F610
2	1	FUSED SAFETY SWITCH, 30 AMP	GE TPF30R
3	2	FUSE, 15 AMP	GOULD TR15R
4	2	LIGHT, FIXTURE, 120V, 100W, PVC	BEV105-0001
5	1	MICROSWITCH, 2PST, 1-N/O, 1-N/C	BEV115-0017
6	1	SWITCH, TOGGLE, 1POLE, 15A, IVORY	BEV115-0009
7	1	FAN, EXHAUST, 10in, 120V, METALLIC	BEV124-0001
8	1	LOUVER, INTAKE, 10in, METALLIC	BEV124-0005
9	1	LOUVER, MOTOR, 120V, METALLIC	BEV124-0009
10	2	THERMOSTAT, 40-105F, SPDT, N4X	BEV124-0019
11	2	HEATER, 120V, 1500W	BEV124-0018
12	1	OUTLET, DUPLEX, 15A, IVORY, STD	BEV115-0001
13	2	THERMOSTAT, HI-TEMP, CUTOUT	BEV124-0020
14	1	TEST KIT HOLDER	BEVCO TKHOLDER
15	2	LIGHT, BULB, 90W, 120V	BEV105-0002
16			
17			
18			
19			
20			

- NOTE - ALL CONDUIT AND FITTINGS TO BE U/L LISTED PVC.
- ① FIBERGLASS DOOR WITH S.S. HINGE. DOOR CAN BE HINGED ON EITHER SIDE.
 - ② LOCKABLE S.S. DOOR HARDWARE.
 - ③ CANOPY WITH INSECT SCREEN.

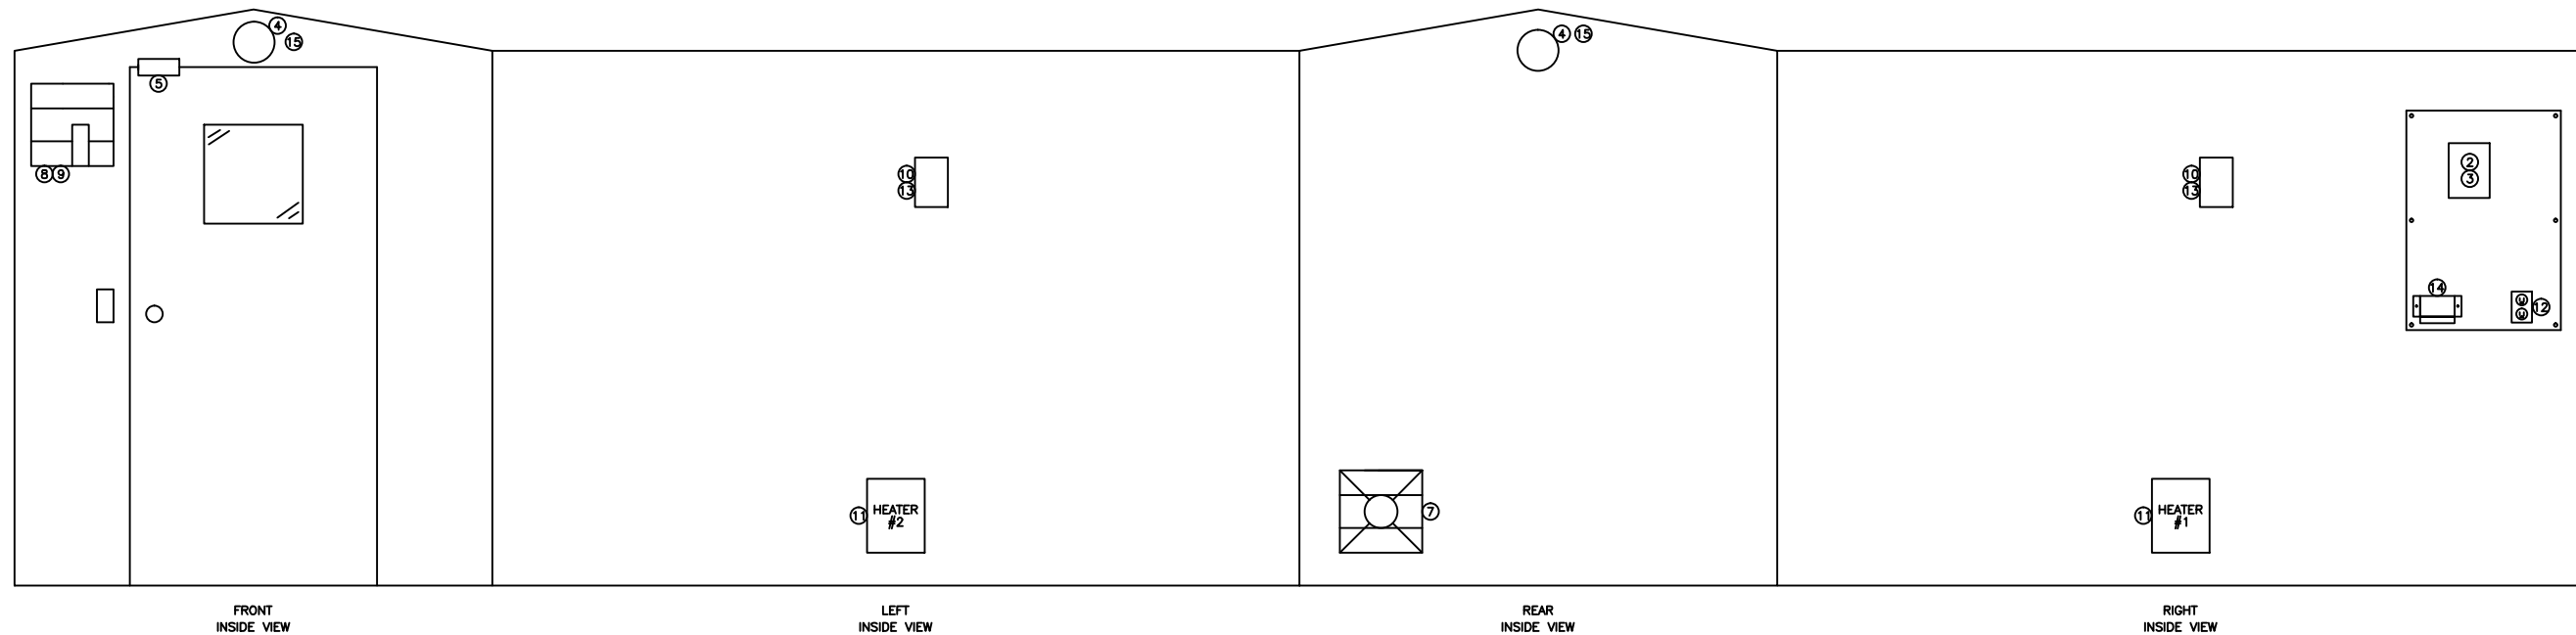

6	09/21/07	REMOVED CONDUIT JUNCTION BOXES	EWS	TITLE ECS-F610 FIBERGLASS BUILDING LEFT SIDE, HINGE 6' X 10' X 7' DRW. BY RLS SCALE NONE DATE 01-18-00 DRAWING NUMBER SD-184	
5	2/5/07	ADD SECOND HOOD/CHG THERMO SYMBOL	SFS		
4	11/28/05	REMOVED CONDUIT RUNS	EWS		
3	4/23/03	CHANGED INCOMING TO 3 WIRE + GND	JLN		
2	02/18/02	REPLACE P/N IN BOX W/ BEV. PART NUMBER	SS		
1	03-14-01	MOVED DOOR SW TO LATCH SIDE	RLS		
NO.	DATE	REVISION	BY	JOB	