


BILL OF MATERIALS

ITEM	QTY.	DESCRIPTION	MGF - PART NUMBER
1	1	BUILDING 6' x 8' x 7'	BEVCO ECS-F68
2	1	FUSED SAFETY SWITCH, 30 AMP	GE TPF30R
3	2	FUSE, 15 AMP	GOULD TR15R
4	2	LIGHT FIXTURE, 120V, 100W, PVC	BEV105-0001
5	1	MICROSWITCH, 2PST, 1-N/O, 1-N/C	BEV115-0017
6	1	SWITCH, TOGGLE, 1POLE, 15A, IVORY	BEV115-0009
7	1	FAN, EXHAUST, 10in, 120V, METALLIC	BEV124-0001
8	1	LOUVER, INTAKE, 10in, METALLIC	BEV124-0005
9	1	LOUVER, MOTOR, 120V, METALLIC	BEV124-0009
10	1	THERMSTAT, 40-105F, SPDT, N4X	BEV124-0019
11	1	HEATER, 120V, 1500W	BEV124-0018
12	1	OUTLET, DUPLEX, 15A, IVORY, STD	BEV115-0001
13	1	THERMSTAT, HI-TEMP, CUTOUT	BEV124-0020
14	1	TEST KIT HOLDER	BEVCO TKHOLDER
15	2	LIGHT, BULB, 90W, 120V	BEV105-0002
16			
17			
18			
19			
20			

NOTE - ALL CONDUIT AND FITTINGS TO BE U/L LISTED PVC.
 ① FIBERGLASS DOOR WITH S.S. HINGE.
 ② LOCKABLE S.S. DOOR HARDWARE.
 ③ CANOPY WITH INSECT SCREEN.

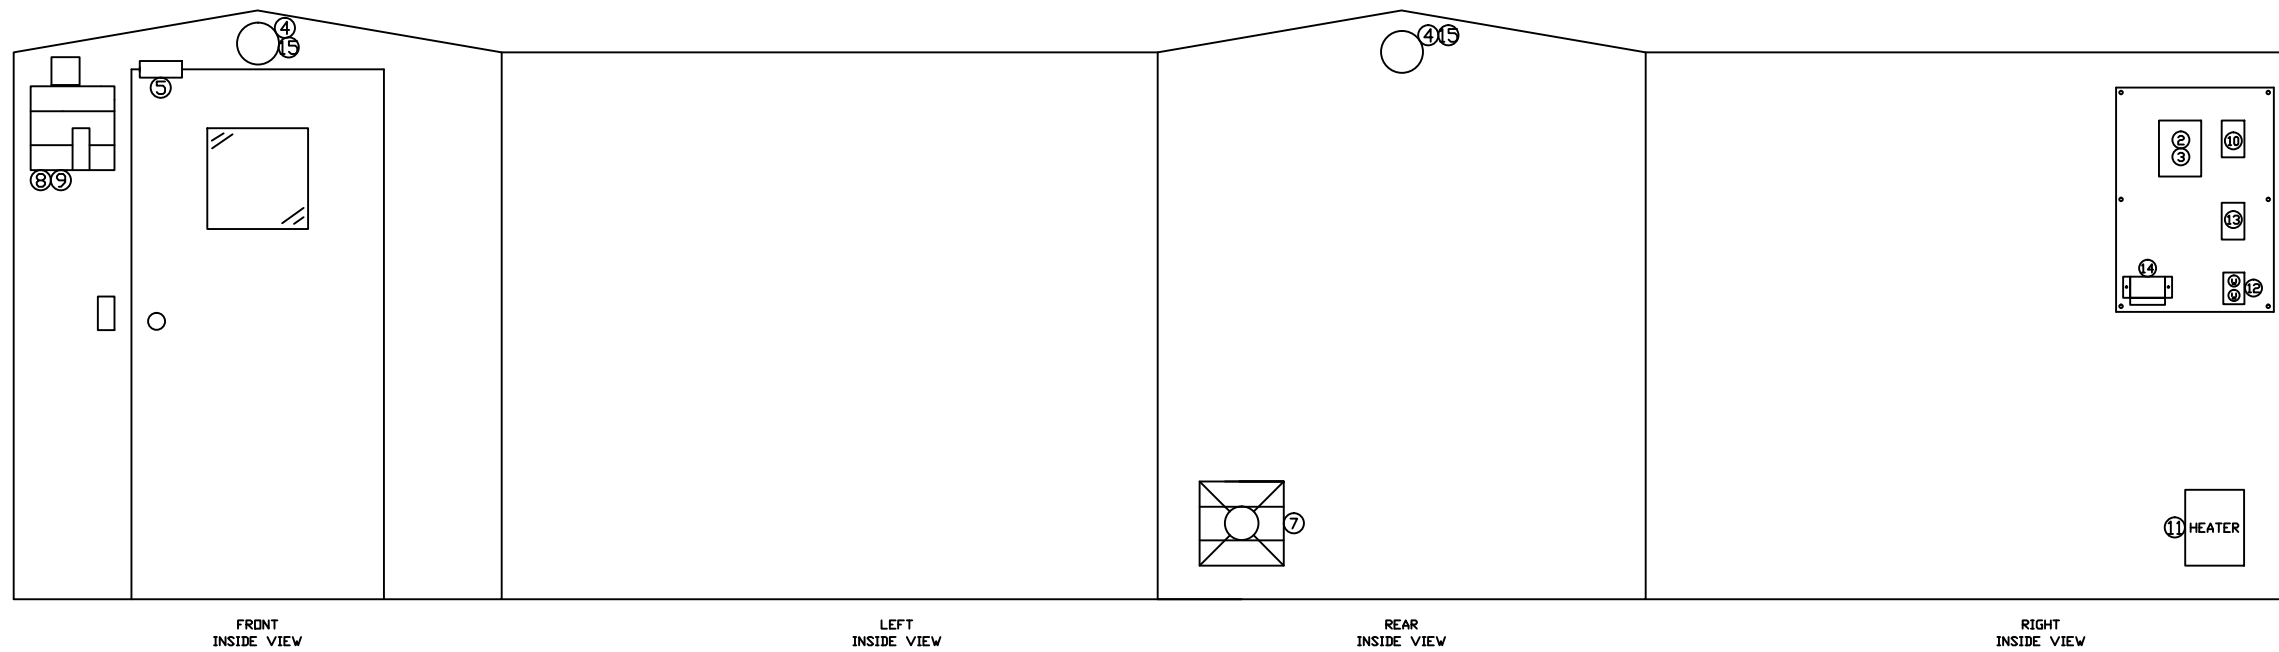

		BEVCO ENGINEERING, INC. SUSSEX WISCONSIN	
		TITLE ECS-F68 FIBERGLASS BUILDING LEFT SIDE HINGE 6' x 8' x 7'	
5	10/23/09	ADD CANOPY OVER EXHAUST FAN	SFS
4	09/18/06	REVISED SUBPANEL LAYOUT	JFH
3	11/23/05	REMOVED CONDUIT & MOVED THERMSTAT	EWS
2	4/22/03	CHANGED INCOMING TO 3 WIRE W/ GND	JLN
1	02/18/02	REPLACE P/N IN BOM W/ BEV. PART NUMBER	SS
NO.	DATE	REVISION	BY
		DRM. BY RLS	DRAWING NUMBER
		SCALE NONE	
		DATE 1-18-00	
			SD-178