


| BILL OF MATERIALS | | | |
|-------------------|------|------------------------------------|-------------------|
| ITEM | QTY. | DESCRIPTION | MGF - PART NUMBER |
| 1 | 1 | BUILDING 7'-6" x 6' x 7' | BEVCO ECS-F86 |
| 2 | 1 | FUSED SAFETY SWITCH, 30 AMP | GE TPF30R |
| 3 | 2 | FUSE, 15 AMP | GOULD TR15R |
| 4 | 2 | LIGHT, FIXTURE, 120V, 100W, PVC | BEV105-0001 |
| 5 | 1 | MICROSWITCH, 2PST, 1-N/O, 1-N/C | BEV115-0017 |
| 6 | 1 | SWITCH, TGGLE, 1POLE, 15A, IVORY | BEV115-0009 |
| 7 | 1 | FAN, EXHAUST, 10in, 120V, METALLIC | BEV124-0001 |
| 8 | 1 | LOUVER, INTAKE, 10in, METALLIC | BEV124-0005 |
| 9 | 1 | LOUVER, MOTOR, 120V, METALLIC | BEV124-0009 |
| 10 | 1 | THERMSTAT, 40-105F, SPDT, N4X | BEV124-0019 |
| 11 | 1 | HEATER, 120V, 1500W | BEV124-0018 |
| 12 | 1 | OUTLET, DUPLEX, 15A, IVORY, STD | BEV115-0001 |
| 13 | 1 | THERMSTAT, HI-TEMP, CUTOUT | BEV124-0020 |
| 14 | 1 | TEST KIT HOLDER | BEVCO TKHOLDER |
| 15 | 2 | LIGHT, BULB, 90W, 120V | BEV105-0002 |
| 16 | | | |
| 17 | | | |
| 18 | | | |
| 19 | | | |
| 20 | | | |

NOTE - ALL CONDUIT AND FITTINGS TO BE U/L LISTED PVC.

① FIBERGLASS DOOR WITH S.S. HINGE.

② LOCKABLE S.S. DOOR HARDWARE.

③ CANDOPY WITH INSECT SCREEN.

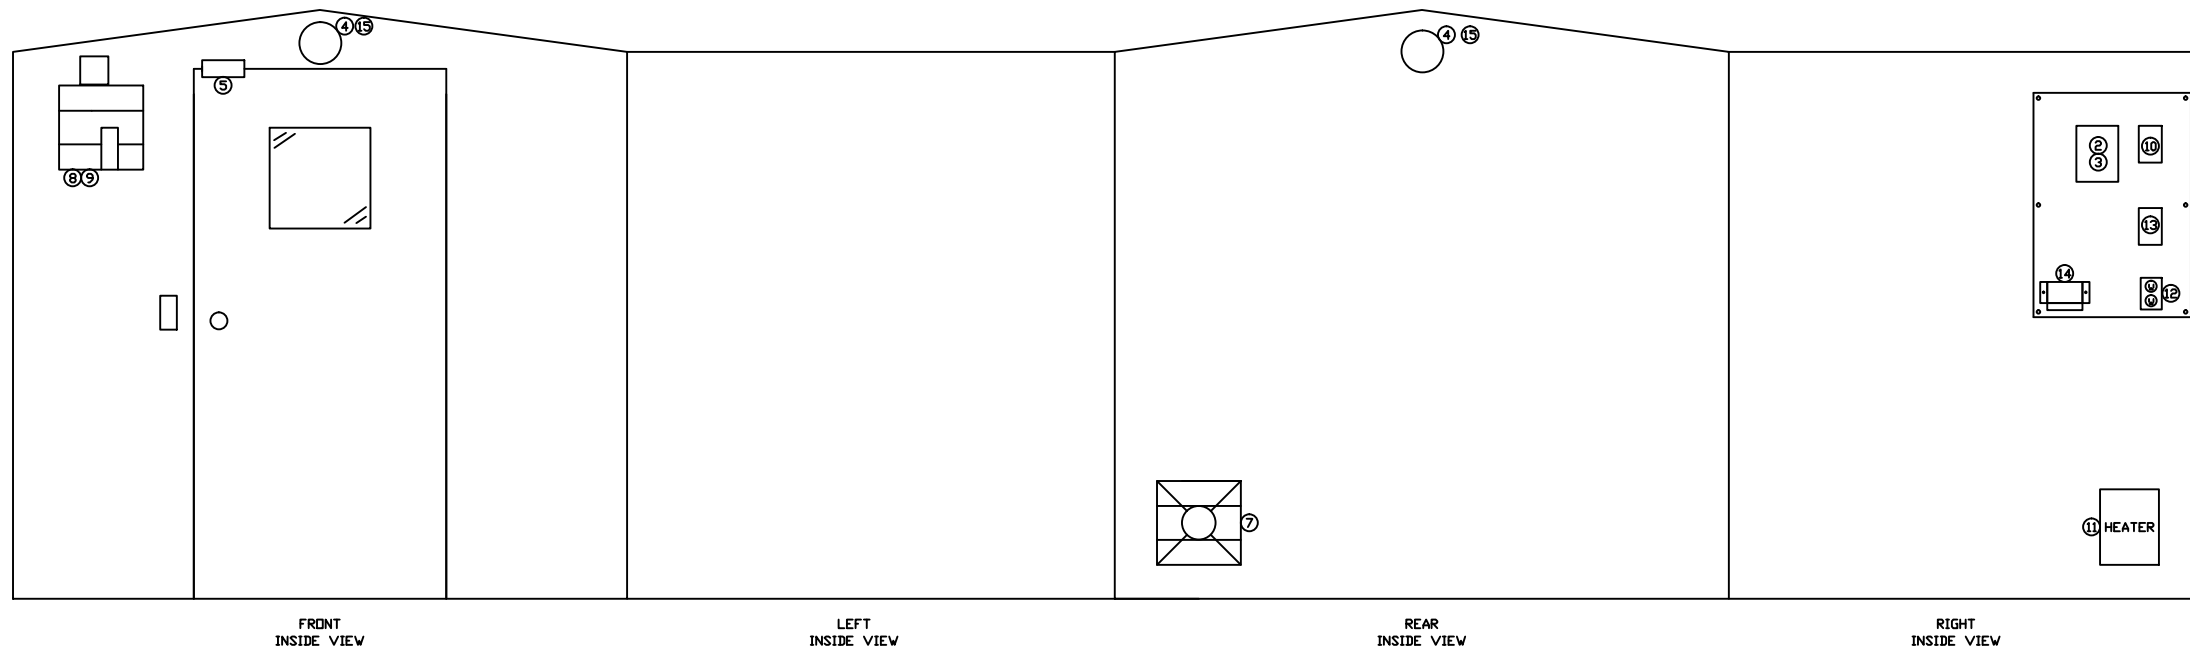

| | | | |
|-----|----------|--|-----|
| | | | |
| | | SUSSEX ENGINEERING, INC. WISCONSIN | |
| | | TITLE ECS-F86 FIBERGLASS BUILDING LEFT SIDE HINGE 7'6" X 6' X 7' | |
| 4 | 09/29/08 | ADDED CANDOPY ON EXHAUST VENT | EWS |
| 3 | 11/28/05 | REMOVED CONDUIT RUN | EWS |
| 2 | 4/22/03 | CHANGED INCOMING TO 3 WIRE W/ GND | JLN |
| 1 | 02/18/02 | REPLACE P/N IN BOX W/ BEV. PART NUMBER | SS |
| NO. | DATE | REVISION | BY |
| | | DRW. BY RLS SCALE NONE DATE 1-18-00 DRAWING NUMBER SD-179 | |